




# PROJECT NO. SC-1121

Location 2 - NW Expressway E of Meridian

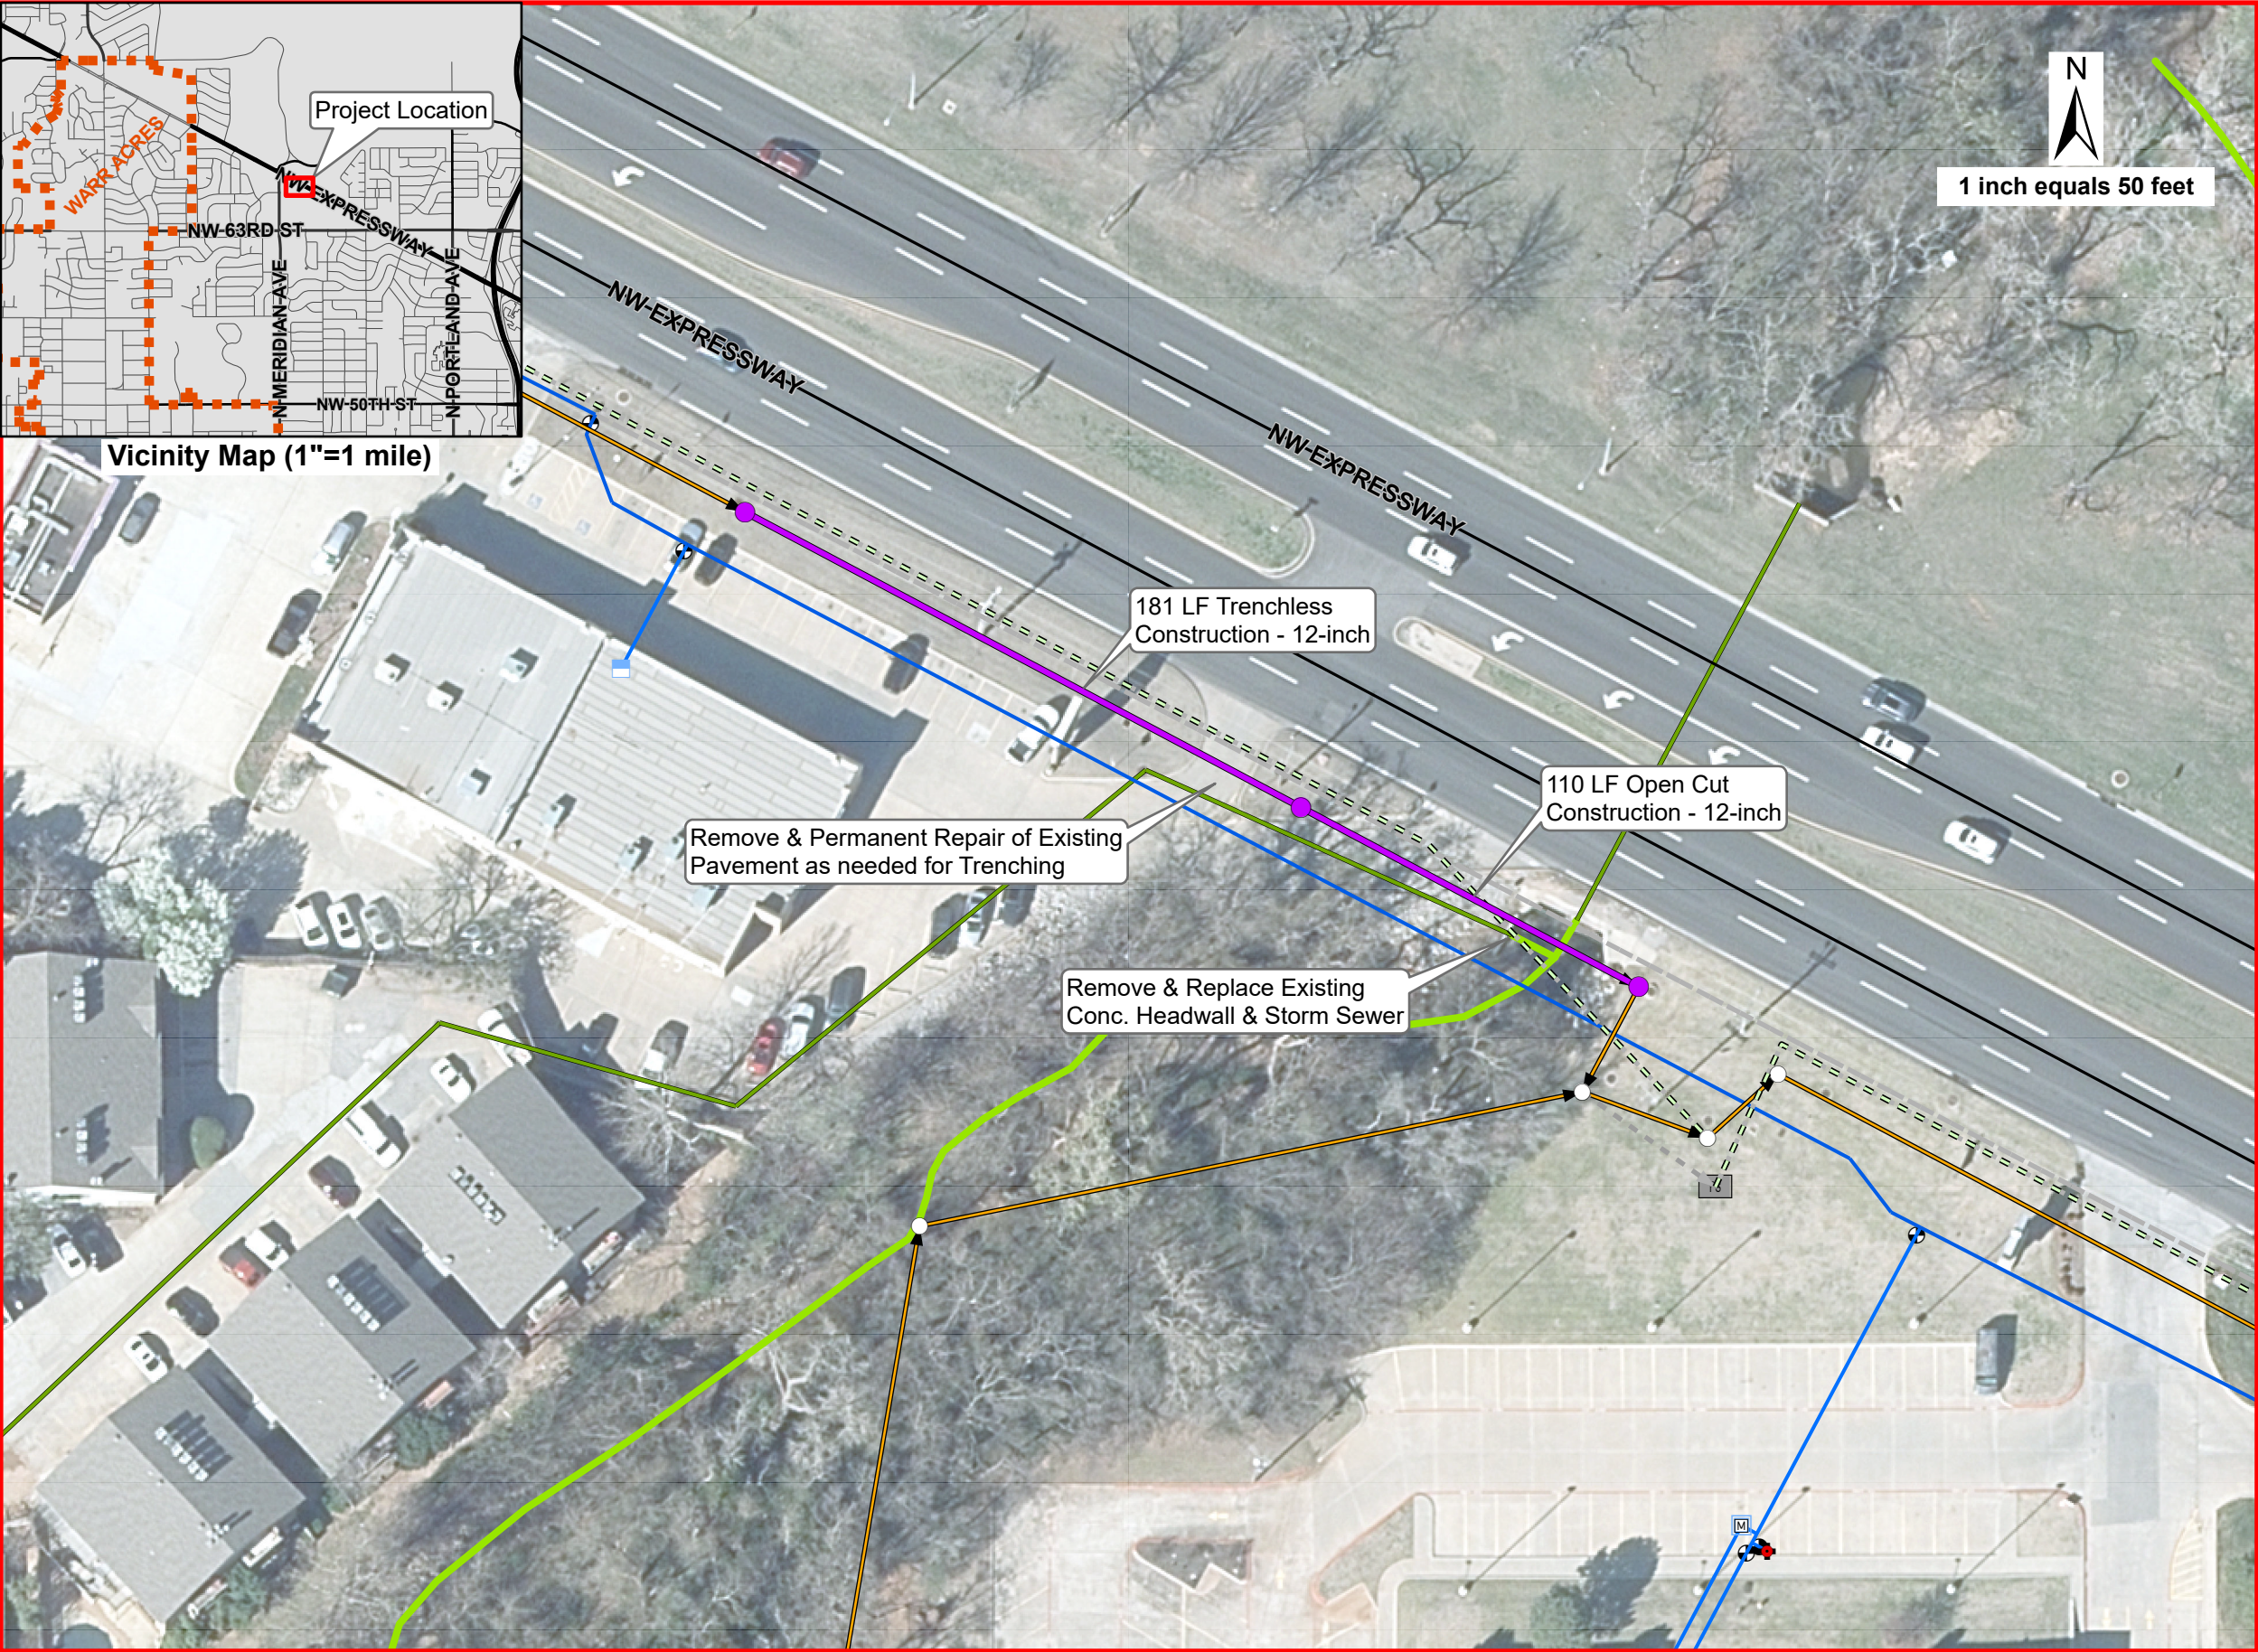

|                          |  |
|--------------------------|--|
| Project No.              | DC-0320/OCWUT SC-1121  |
| Project Title            | Emergency Sanitary Sewer Repairs   |
| Project Location         | Location 2 - NW Expressway E of Meridian   |
| Ward                     | 2  |
| Core Business Initiative | Reliability and Resiliency   |
| Project Need             | To replace existing concrete sewer pipe and cast iron pipe (CIP) that has collapsed.   |
| Project Details          | Replacement of approximately 289 linear feet of 8-inch concrete pipe and 291 linear feet of 12-inch CIP with new PVC and HDPE pipe. Adjoining manholes will be rehabilitated and as shown. |
| Project Manager          | Bryan Haskins  |
| Project Consultant       | In House   |
| Contractor               | Cimarron Construction Company  |
| Contract Amount          | \$523,626  |
| Completion Date          | August 2023  |

## Legend

- Existing Sanitary Sewer Main
- Existing Sanitary Sewer Manhole
- Abandoned Sewer Main
- Abandoned Sewer Manhole
- Abandoned Sewer Force Main
- Existing Water Main
- Existing Water Valve
- Existing Fire Hydrant
- Existing Storm Sewer
- Existing Drainage Channel
- Proposed Sewer Alignment
- Proposed Sewer Manhole Rehab